

—
KRONOTERM 1976
HEAT PUMPS



—
DATA SHEET

—
ESSENTA
DHW heat pump
ESSENTA system

Data Sheet - ESSENTA - EN / 98-25-23-220176-03

This work is protected by copyright.

Any use of this document outside of the copyright and Related Rights Act and without the express consent of KRONOTERM d.o.o. is illegal and punishable by fine.

Despite taking extensive care to ensure the accuracy of all figures and descriptions, KRONOTERM d.o.o. reserves the right to make corrections, changes to technical details, and changes to figures with no prior notice. Information herein is given based on the latest available product information at the time of drafting and printing this document. We also reserve the right to suspend the sales of an individual product or even the entire sales program.

All updates are available in digital format. Please contact your chosen system administrator for access.

Figures are symbolic and are only intended as a reference. Despite our efforts we cannot ensure that the products' true colors, proportions, or other graphical elements will be faithfully represented in print and on electronic screens. Products may differ from their visual representations.

Printed in Slovenia.

The original documentation is written in Slovenian. All other languages are translations.

Write to info@kronoterm.com for any additional questions.

TABLE OF CONTENTS

DESCRIPTION	4
NOMENCLATURE.....	5
ESSENTA DHW HEAT PUMP	6
AIR INLET AND OUTLET CONFIGURATION POSSIBILITIES	8
Ambient air configuration	8
Ducted air configuration	8
ADDITIONAL EQUIPMENT ESSENTA.....	9
Sample installation diagram.....	9
ADDITIONAL EQUIPMENT ESSENTA.....	10
REGULATOR.....	11
CLOUD.KRONOTERM.....	12
TECHNICAL DATA	13
SOUND	15
OPERATING ENVELOPE.....	16
WATER HEATING TIME.....	17
EFFICIENCY (COP).....	18
AVAILABLE HOT WATER VOLUME.....	19
BASIC INSTALLATION DIAGRAM.....	20
Ambient air configuration	20
Air source switching.....	21
Ducted air configuration	22
Exhaust air utilisation from heat recovery.....	23
Cascade connection.....	24
Biomass furnace connection	25

WELCOME TO THE KRONOTERM FAMILY!

This data sheet describes the technical features of the ESSENTA DHW heat pump system.

DESCRIPTION

ESSENTA is easy to install and use. Simply install it, turn it on, and forget about it. With its simple yet sophisticated design, it provides heating for 300 liters of domestic hot water up to 65 °C in an efficient (COP(A20) 4,16), economical, environmentally friendly, and straightforward manner. It ensures reliable operation even at air temperatures as low as -10 °C.

Usage

When set to a temperature of 65 °C, it provides more than 500 liters of usable domestic hot water at 40 °C. It is therefore intended for use in households and smaller service and public activities that require domestic hot water for their daily operations (hair and beauty salons, kindergartens etc.).

Air inlet and outlet connections allow up to five different installation configurations. For its operation, ESSENTA can utilize either external or ambient air or waste exhaust air from other devices. With the installation of appropriate valves, it is also possible to switch between the listed sources.


Technology

- **AFT™ – AirFlow Technology** - The aerodynamic design with a separate compressor section allows unobstructed air flow through the evaporator. Reduced air resistance increases fan efficiency, reduces noise, and extends the device's lifespan.
- **SPF™ – Smart Placement Flexibility** - Angular connections and modular design allow placement as close as 20 cm from the wall and adjustment of intake and exhaust from the top or side – ideal for installation in basements and utility rooms.
- **MCS™ – MultiConnect System** - Extended connectivity options with other heat sources (gas, oil, pellets, solar energy), BMS systems, and smart grids.
- **AFA™ – AirFlow Adapt** - The intelligent air source integration system allows for the adjustment of intake and exhaust (spatial or ducted intake) and switching between indoor, outdoor, and waste air. Optimizes flow for quiet and efficient operation in all configurations.
- **IHS™ – Insta Heat System** - Rapid heating with the help of a built-in 1,5 kW heater and boost function for immediate preparation of larger quantities of domestic hot water with temperatures up to 75 °C.
- **NMS™ – Noise Management System** - An advanced system designed to achieve exceptionally low noise levels, combining intelligent heat pump module design, premium insulation materials, and optimized airflow.
- **OHS™ – Optimal Hygiene System** - Comprehensive approach to hot water hygiene – enameled buffer tank, dual magnesium anode, and external condenser to prevent limescale and bacteria buildup. Ensures long lifespan and safety of hot water.
- **SC – SmartCost** - Low electricity consumption and high efficiency, along with the possibility of weekly and daily programming, enable savings in systems with multi-tariff electricity billing.
- **EAS™ – Easy Access System** - Access to the main components of the device is provided from the top through a thoughtfully designed cover, allowing easy service even in rooms with lower ceiling height.
- **Low GWP – Global Warming Potential** - The heat pump has a low environmental impact as it uses an eco-friendly, non-toxic refrigerant propane (R290) with a GWP of 0,02.

NOMENCLATURE

ESSENTA-303 / 1 E D PV P3

ESSENTA	DHW heat pump family designation
30	Tank volume (300 l)
3	Device generation
1	No. of heat exchangers in DHW tank
E	El. heater integrated
D	Defrosting – passive and active
PV	Smart Grid compatibility
P3	Outputs for: - External pump for DHW heating with gas, oil or pelet boiler - Recirculation pump - Air valves for heat source switching
A	Variant with thermal safety valve
1	Version

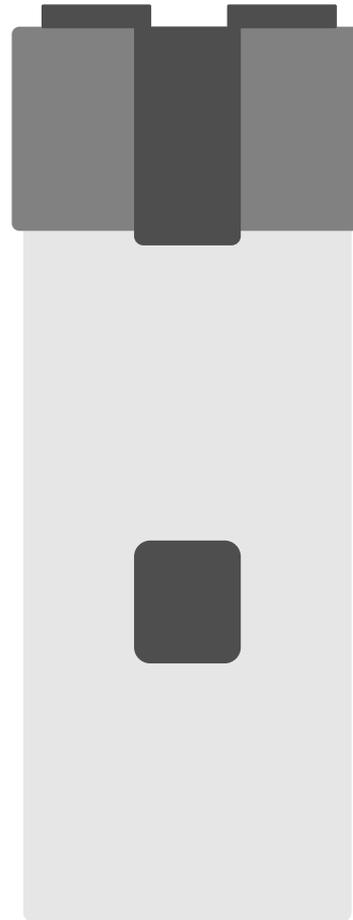

ESSENTA DHW HEAT PUMP

Version

DHW heat pump, 300 l

Model

ESSENTA-303 / 1 E D PV P3



Description and dimensions

- Robust design, high efficiency and user-friendly operation
- 300-l enamelled DHW tank with closed cell high density PU foam ensures extremely low heat losses
- Various installation methods and configurations with or without air-ducts DN 160
- Four positions of air inlet / outlet connections: 2x top, 2x side
- Suitable for installation in rooms with ceilings at least 2,1 m high
- Flexible air intake configuration includes two closing caps

Variants

ESSENTA -303 / 1 E D PV P3 AI

- with additional thermal safety valve

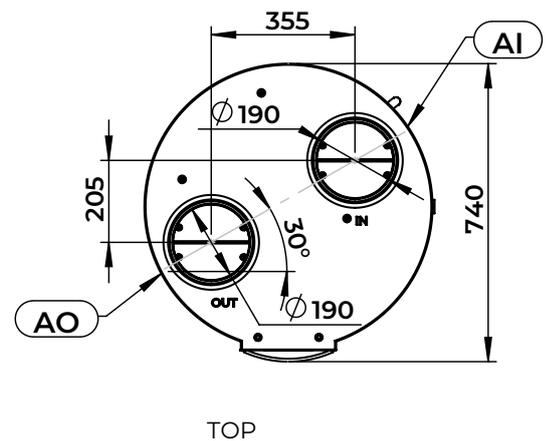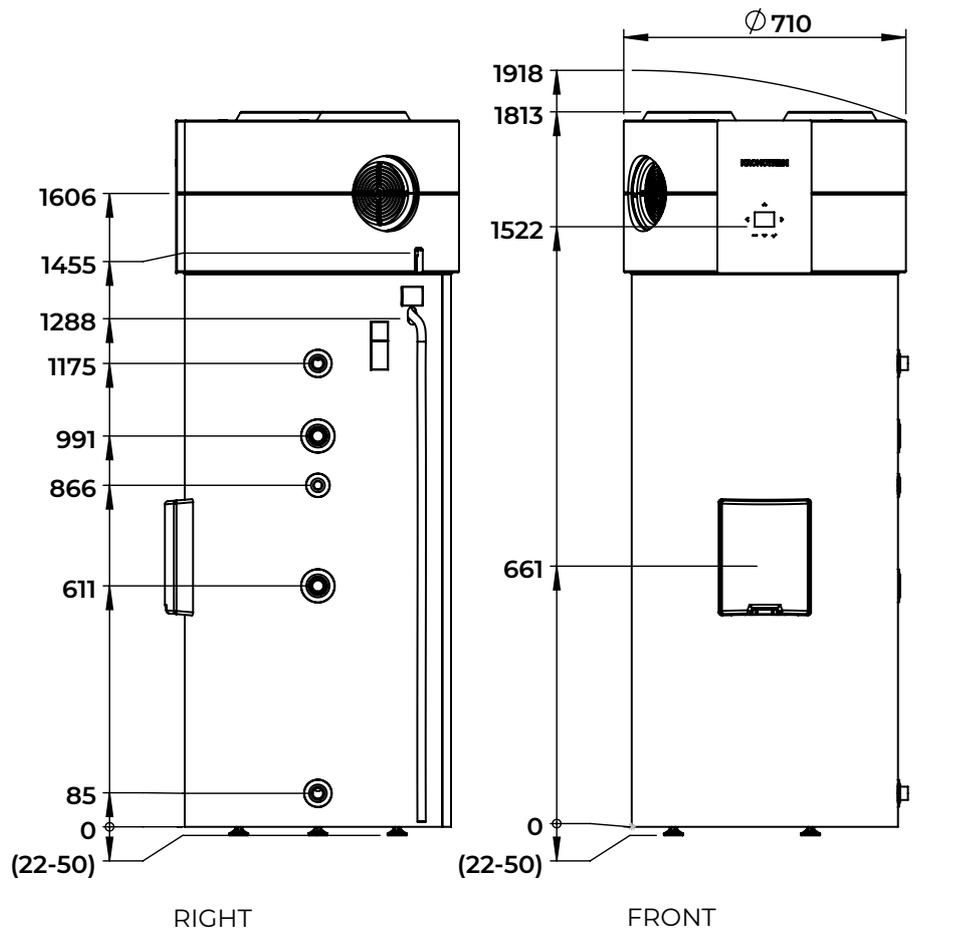

Legend


AI Air inlet 190/160 mm (f)

AO Air outlet 190/160 mm (f)

ESSENTA DHW HEAT PUMP

Primary components


- B** Heat pump unit
- C** Control panel
 - Display
 - Heat pump regulator
- D** DHW Tank
- E**
 - Flange
 - Electric heater
 - Magnesium anode
- F** Cable conduit
 - Power supply
 - External pumps and valves
 - External temperature sensor
 - SG signals
- G** Temperature sensor channel
- H** Condensate drain tube

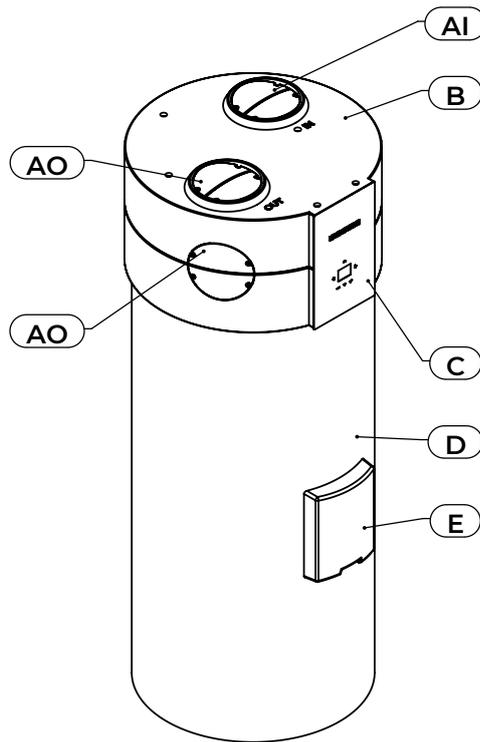

Legend

- AI** Air inlet 190/160 mm (f)
- AO** Air outlet 190/160 mm (f)
- CW** Domestic cold water G 1" ET
- FS** Heat exchanger for DHW heating with external heat generator - flow G 1" IT
- HW** Domestic hot water G 1" ET
- RC** Recirculation - domestic water G 3/4" IT
- RS** Heat exchanger for DHW heating with external heat generator - return G 1" IT


LEFT FRONT

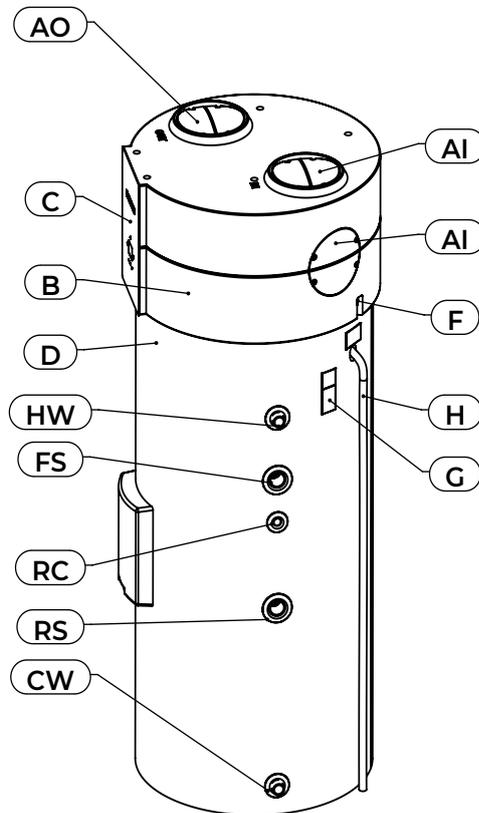





RIGHT

AIR INLET AND OUTLET CONFIGURATION POSSIBILITIES

Ambient air configuration

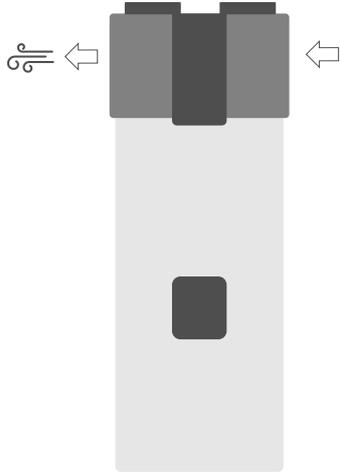


Ducted air configuration

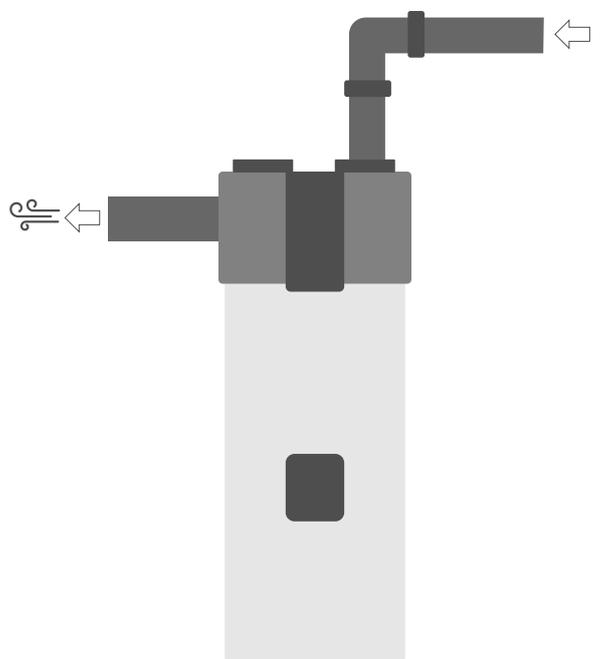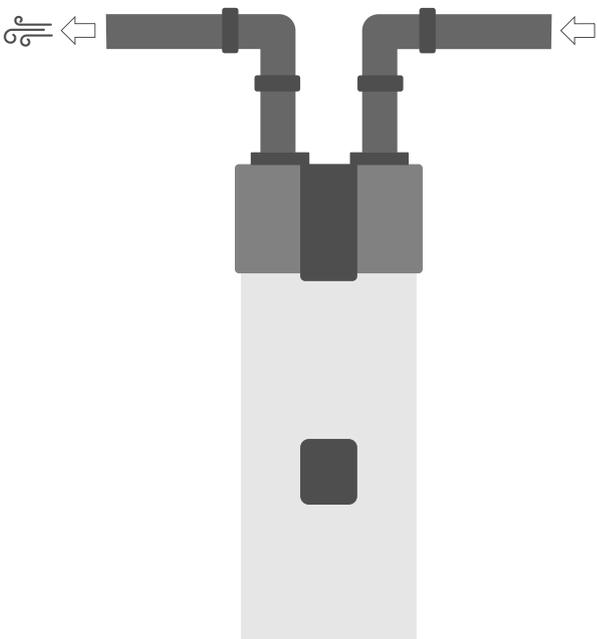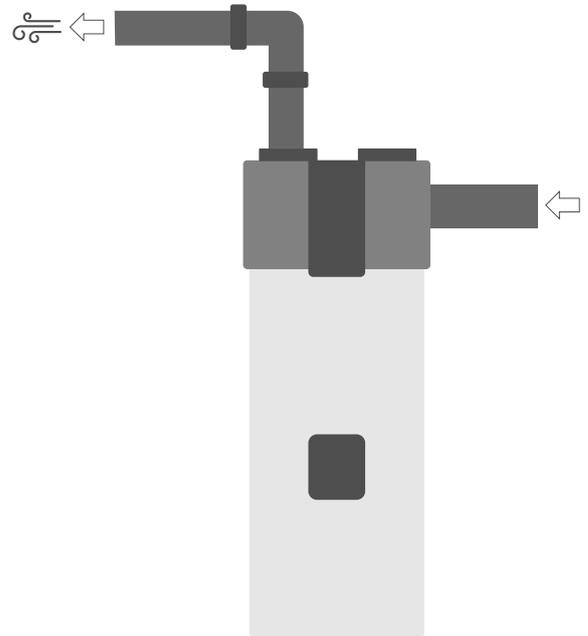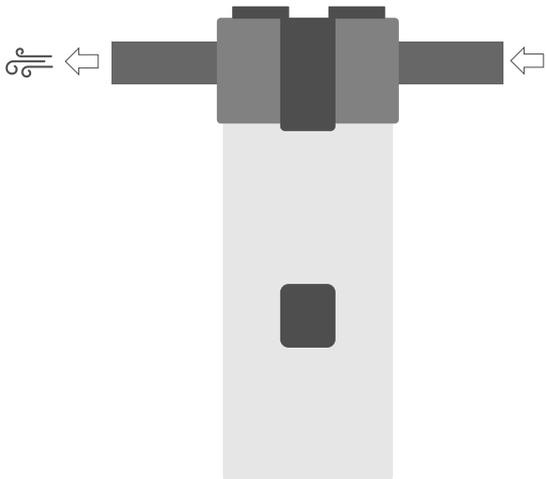

]

ADDITIONAL EQUIPMENT ESSENTA

Sample installation diagram

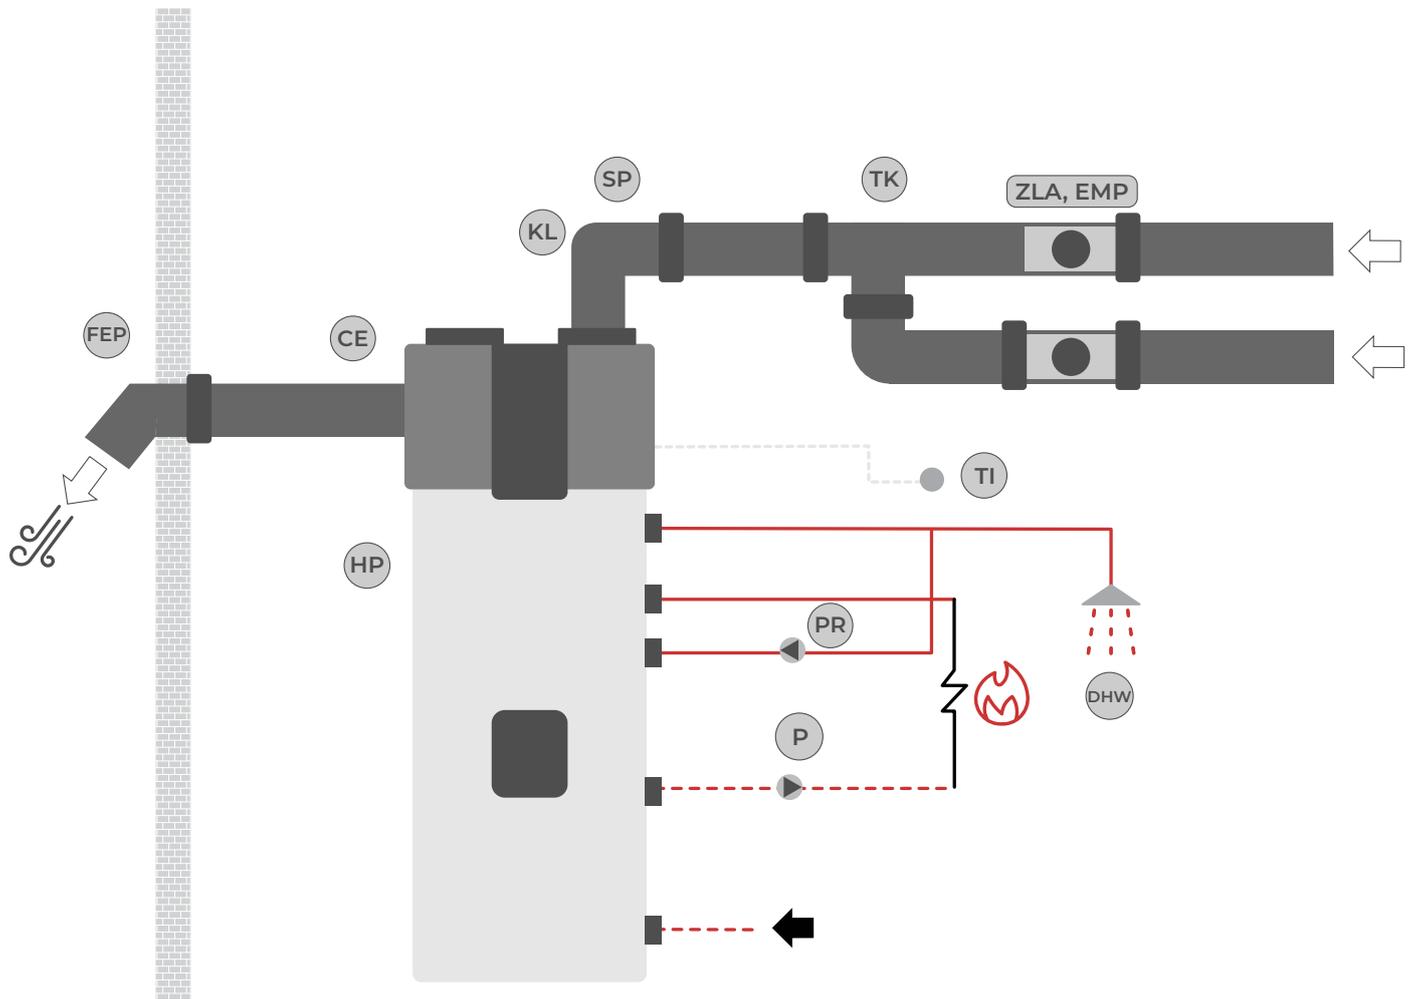

Legend


CE	Pipe
FEP	Facade element
HP	Heat pump
KL	Elbow
P	Circulation pump
PR	Circulation pump for domestic water recirculation
SP	Ventilation pipe coupling
TI	Temperature sensor
TK	T-piece
ZLA, EMP	Butterfly valve with drive

ADDITIONAL EQUIPMENT ESSENTA

CIRCULATION PUMP

High-efficiency circulation pump for heating or cooling with communication and power cable and configurable operating mode


- OC_KT_KPL 25-180/8-75/i PWM2 12



CIRCULATION PUMP FOR DOMESTIC WATER RECIRCULATION

High-efficiency circulation pump for domestic water recirculation, with ball shut-off valve, non-return valve, timer, thermostatic valve and thermal disinfection detection, threaded connection, electrical power 5 - 7 [W], max. flow 0,4 [m³/h], max. pressure 10 [bar]

- OC_STAR-Z NOVA T



BUTTERFLY VALVE WITH ACTUATOR BRACKET

Shut-off, airtight butterfly valve, with a galvanised sheet metal housing and slats, with a drive bracket 160 [mm]


- ZLA_SKG-A 160



ACTUATOR FOR A BUTTERFLY VALVE FOR BUTTERFLY VALVE

ON/OFF, 230 [V]


- EMP_LM230A



PIPE

Insulated pipe for ventilation, inner diameter 160 [mm], length 2 [m]


- CE_AF 160X2000



ELBOW

Elbow for a ventilation pipe 160 [mm]


- KL_AF 160 – 90 (90°)
- KL_AF 160 – 45 (45°)
- KL_AF 160 – 30 (30°)



T-PIECE

T-piece for a ventilation pipe 160 [mm]

- TK_AF 160-160-160



VENTILATION PIPE COUPLING

Coupling for ventilation pipe, 160 [mm]


- SP_AF 160



FACADE ELEMENT

Facade element for ventilation pipe, 160 [mm]

- FEP_160-A (ANTHRACITE)



TEMPERATURE SENSOR

Temperature sensor for the utilisation of heat from a biomass furnace, cable length 5 [m]

- TI_NTC ESSENTA



REGULATOR

Model mark

KSM Lite

Description

DHW heat pump regulator

Functional characteristics

- DHW heat pump control
- Domestic water heating (3 modes)
- Boost function
- Defrosting function
- Electrical heater control
- Daily and weekly schedules
- Thermal disinfection (anti-legionella programme)



- Control:
 - Output for additional heat generators (gas, oil or pellet boiler). With an additional temperature sensor the utilisation of solar or biomass heat is also possible
 - Air valves for switching between heat sources
 - Output for recirculation pump

- Connectivity options:
 - BMS via MODBUS RS485 protocol
 - KSM 2 heat pump system regulation*
 - Smart-grid compatible

User interface:

- Intergrated display with function buttons
- Mobile appliaction through bluetooth connection*

*coming soon

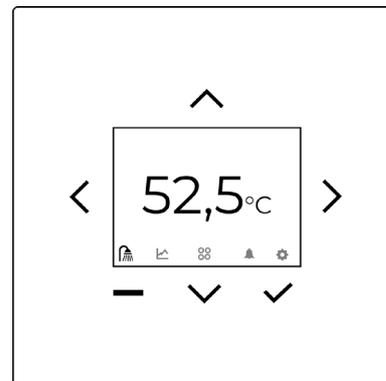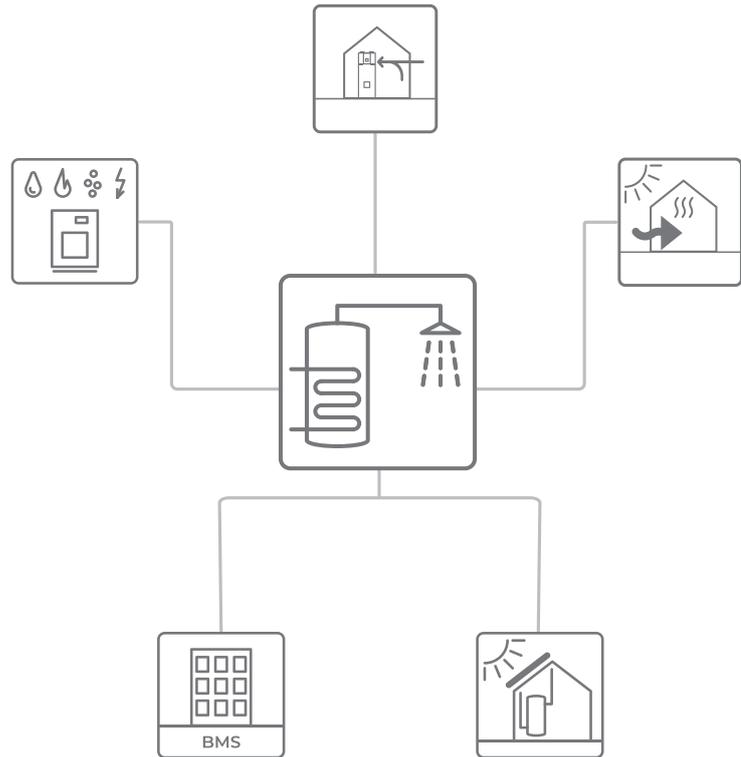


User interface of the DHW heat pump

CLOUD.KRONOTERM

Description

CLOUD.KRONOTERM gives you oversight and control over your heat pump, its consumption and operational costs.

NOTE: The device will be compatible with the new HOME. CLOUD platform, which will be available soon.

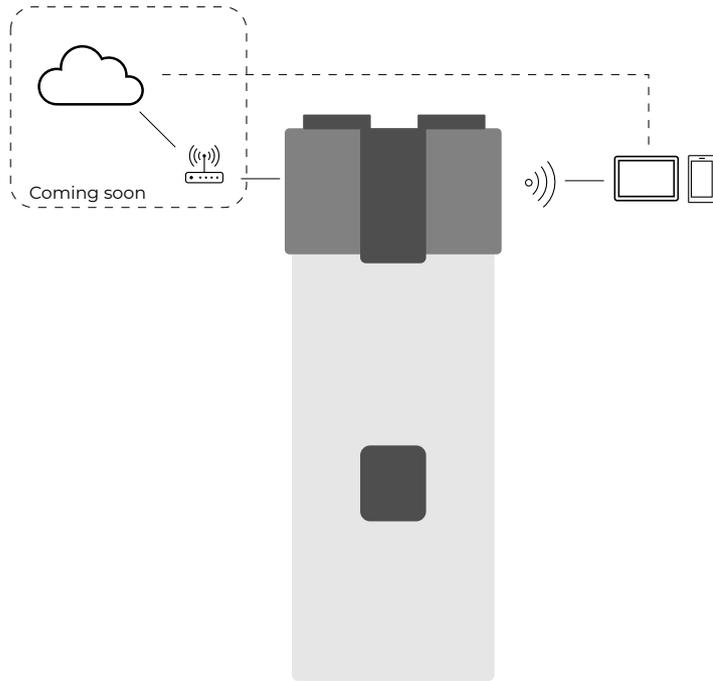

TECHNICAL DATA

DEVICE	Unit	ESSENTA 303
Heat source		air
Controller		KSM Lite
Defrosting		Active (hot gas defrost) and passive (air)
El. heater	kW	1,5
Air duct fittings	DN	160
Air flow - nominal (indoor air installation)	m ³ /h	400
Air flow - nominal (outdoor air installation - duct connection)	m ³ /h	400
Maximum available external pressure drop - nominal flow (duct connection)	Pa	207

EFFICIENCY - PERFORMANCE DATA ACCORDING TO EN 16147 AND DELEGATED REGULATION (EU) 812/2013

Load profile	XL
--------------	----

PERFORMANCE DATA FOR INDOOR AIR OPERATION A20/W10-53.5 (AIR INLET AND AMBIENT TEMPERATURE 20 °C) - AVERAGE, COLDER AND WARMER CLIMATE ZONE

Coefficient of Performance (COP _{dhw})	-	4,16
Heating up time	h:min	8:45
Heating up electrical energy consumption	kWh	3,38
Stand-by power input (Pes)	W	27
Maximum volume of mixed water at 40 °C	l	393
Reference hot water temperature	°C	53,2
Water heating energy efficiency (η _{wh})	%	172
Annual electrical energy consumption (AEC)	kWh/annum	975
Nominal heating capacity	kW	1,57

PERFORMANCE DATA FOR EXHAUST AIR OPERATION A20/W10-53.5 (EXHAUST AIR AND AMBIENT TEMPERATURE 20 °C) - AVERAGE, COLDER AND WARMER CLIMATE ZONE

Coefficient of Performance (COP _{dhw})	-	3,97
Heating up time	h:min	9:08
Heating up electrical energy consumption	kWh	3,48
Stand-by power input (Pes)	W	25
Maximum volume of mixed water at 40 °C	l	399
Reference hot water temperature	°C	53,3
Water heating energy efficiency (η _{wh})	%	163
Annual electrical energy consumption (AEC)	kWh/annum	1025
Nominal heating capacity	kW	1,52

PERFORMANCE DATA FOR OUTDOOR AIR OPERATION A7/W10-53.5 (AIR INLET 7 °C AND AMBIENT TEMPERATURE 20 °C) - AVERAGE CLIMATE ZONE

Coefficient of Performance (COP _{dhw})	-	3,61
Heating up time	h:min	10:19
Heating up electrical energy consumption	kWh	3,87
Stand-by power input (Pes)	W	28
Maximum volume of mixed water at 40 °C	l	399
Reference hot water temperature	°C	53,3
Water heating energy efficiency (η _{wh})	%	149
Annual electrical energy consumption (AEC)	kWh/annum	1127
Nominal heating capacity	kW	1,35

PERFORMANCE DATA FOR OUTDOOR AIR OPERATION A2/W10-53.5 (AIR INLET 2 °C AND AMBIENT TEMPERATURE 20 °C) - COLDER CLIMATE ZONE

Coefficient of Performance (COP _{dhw})	-	2,90
Heating up time	h:min	14,29
Heating up electrical energy consumption	kWh	4,87
Stand-by power input (Pes)	W	30
Maximum volume of mixed water at 40 °C	l	386
Reference hot water temperature	°C	53,3
Water heating energy efficiency (η _{wh})	%	119
Annual electrical energy consumption (AEC)	kWh/annum	1408
Nominal heating capacity	kW	0,94

PERFORMANCE DATA FOR OUTDOOR AIR OPERATION A14/W10-53.5 (AIR INLET 14 °C AND AMBIENT TEMPERATURE 20 °C) - WARMER CLIMATE ZONE

Coefficient of Performance (COP _{dhw})	-	3,97
Heating up time	h:min	8:56
Heating up electrical energy consumption	kWh	3,46
Stand-by power input (Pes)	W	25
Maximum volume of mixed water at 40 °C	l	398
Reference hot water temperature	°C	53,3
Water heating energy efficiency (η _{wh})	%	163
Annual electrical energy consumption (AEC)	kWh/annum	1025
Nominal heating capacity	kW	1,56

DEVICE	Unit	ESSENTA 303
ENERGY EFFICIENCY CLASS ACCORDING TO EU REGULATION NO. 812/2013		
Energy efficiency class for indoor air condition	-	A++
Energy efficiency class for exhaust air condition	-	A++
Energy efficiency class for outdoor air condition	-	A+

ELECTRICAL DATA

Rated voltage	V/Hz	230/50
Max. operation current	A	10,5
Nominal electrical power	W	500*
Max. electrical power	W	2170
Electrical power - electric heater	W	1500
Additional electrical load	W	100
Fuses	A	16
Electrical power cable	mm	/
Protection class	-	IP X1

* max power (without el. heater) at A20W53

COMMUNICATION

Connection to BMS		Modbus RTU, RS 485
Mobile app		Bluetooth*
Internet connection		Additional equipment*

* Coming soon

COOLING SYSTEM

Refrigerant - type		R290
Refrigerant - industrial designation		HC-290 (R290)
GWP (global warming potential)		0,02
Total CO ₂ equivalent of charged refrigerant		0,003
Refrigerant - quantity	kg	0,15
Max. refrigerant system operating pressure	MPa	3,1

DIMENSIONS AND WEIGHT - TRANSPORT

Dimensions (W x H x D)	mm	755 x 1975 x 735
Weight	kg	166

DIMENSIONS AND WEIGHT - NET

Dimensions (W x H x D)	mm	710 x 1813 x 740
Weight	kg	148

RANGE OF OPERATION

Water (heat pump only)	°C	65
Water (heat pump + additional el. heater)	°C	75
Air	°C	-10 / 45

DHW- TANK DATA

Volume	l	300
Maximum allowed operating pressure in the heat exchanger (at 110 °C)	MPa	1,0 MPa (10 bar)
Volume of heat exchanger	l	8
Internal heat exchanger surface	m ²	1,2
Maximal thermal power of the heat exchanger*	kW	48,9
Pressure, max.	MPa	1,0 (10 bar)
Standby heat losses according to EN12897	kWh/day	2,08

DHW - WATER TANK CONNECTIONS


Cold and hot water (CW, HW)	"	G 1
DHW recirculation (RC)	"	G 3 / 4
Flow and return, external boiler (FS, RS)	"	G 1
Condensate drain (Ø)	mm	16

* Max heating capacity of heat exchanger at supply temperature 90 °C, return temperature 55 °C and DHW temperature 45°C.

SOUND

Description

- Sound power is a characteristic of a sound source and is not related to distance. It describes the total sound energy of an appropriate source that is emitted in all directions.
- Sound pressure depends on the measurement site in the sound field and describes the sound pressure at that location.
- When sound is transmitted through the structure, it is necessary to equip the connection with absorbers or compensators to prevent the transmission of unwanted structural sound.

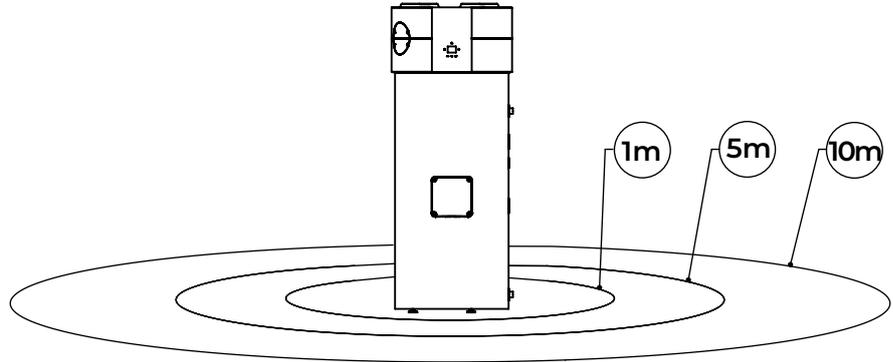


DEVICE	Unit	ESSENTA 303
SOUND POWER LEVEL MEASUREMENT BASED ON EN 12102 / EN ISO 9614-2, ACCURACY CLASS 2		
SOUND POWER UNDER INDOOR AIR CONDITION		
Sound power level LW under indoor air condition	dB (A)	55
Sound pressure level Lp under indoor air condition (with directivity factor Q = 2 and distance 2 m)	dB (A)	40
SOUND POWER UNDER OUTDOOR AIR CONDITION (DUCT CONNECTION)		
Sound power level LW under outdoor air conditions - indoor	dB (A)	56
Sound pressure level Lp under outdoor air condition (with directivity factor Q = 2 and distance 2 m) - indoor	dB (A)	41
Sound power level LW under outdoor air condition - outdoor	dB (A)	59
Sound pressure level Lp under outdoor air condition (with directivity factor Q = 2 and distance 2 m) - outdoor	dB (A)	44
Sound power level LW under outdoor air condition - outdoor*	dB (A)	52
Sound pressure level Lp under outdoor air condition (with directivity factor Q = 2 and distance 2 m) - outdoor*	dB (A)	37
SOUND POWER UNDER EXHAUST AIR CONDITION (DUCT CONNECTION)		
Sound power level LW under exhaust air condition - indoor	dB (A)	53
Sound pressure level Lp under exhaust air condition (with directivity factor Q = 2 and distance 2 m) - indoor	dB (A)	38
Sound power level LW under exhaust air condition - outdoor	dB (A)	48
Sound pressure level Lp under exhaust air condition (with directivity factor Q = 2 and distance 2 m) - outdoor	dB (A)	33
Sound power level LW under exhaust air condition - outdoor*	dB (A)	33
Sound pressure level Lp under exhaust air condition (with directivity factor Q = 2 and distance 2 m) - outdoor*	dB (A)	17


*By using a duct silencer on the air discharge duct.

OPERATING ENVELOPE

Ambient air configuration

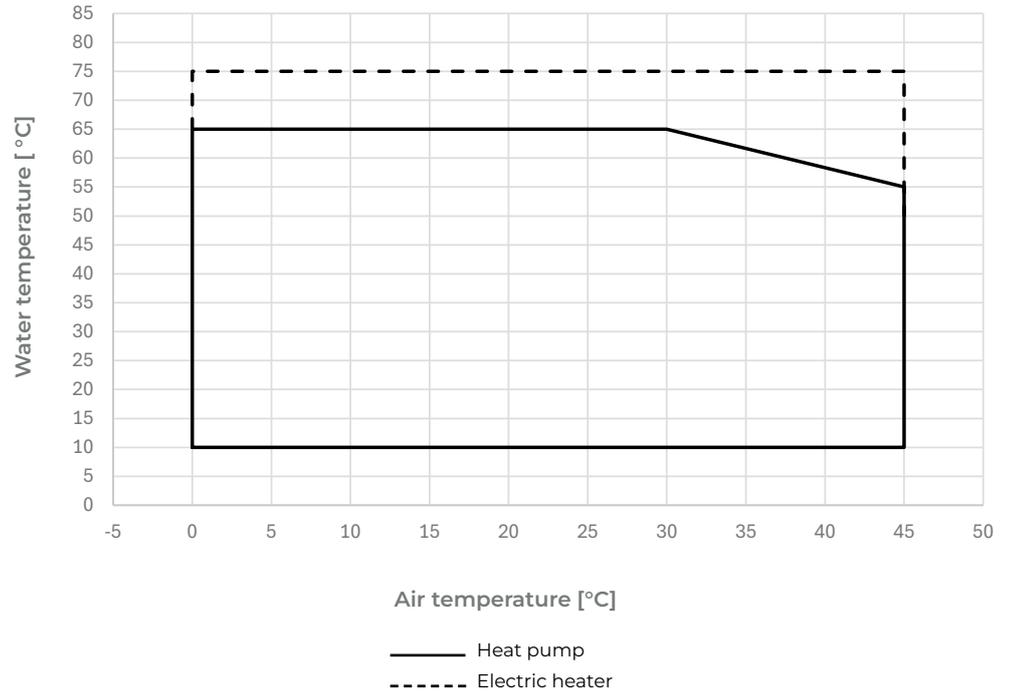


Ducted air configuration

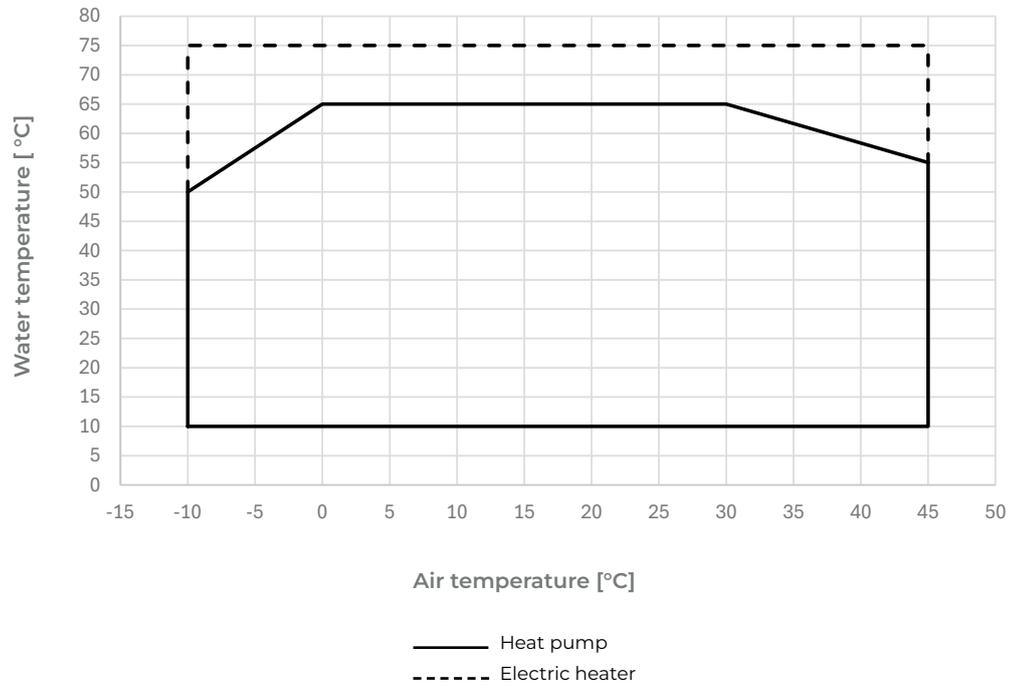


WATER HEATING TIME

Ambient air configuration

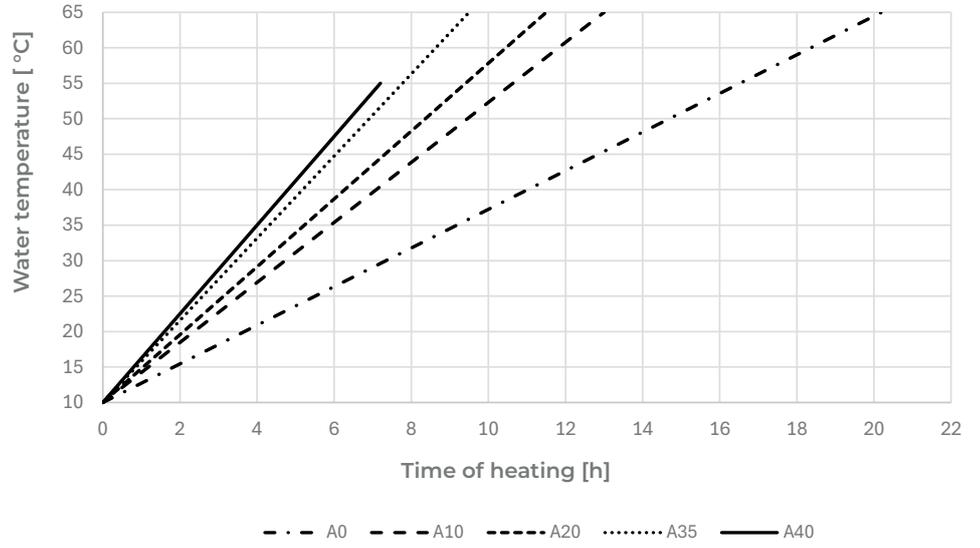


Ducted air configuration
(at an ambient temperature of 20 °C)

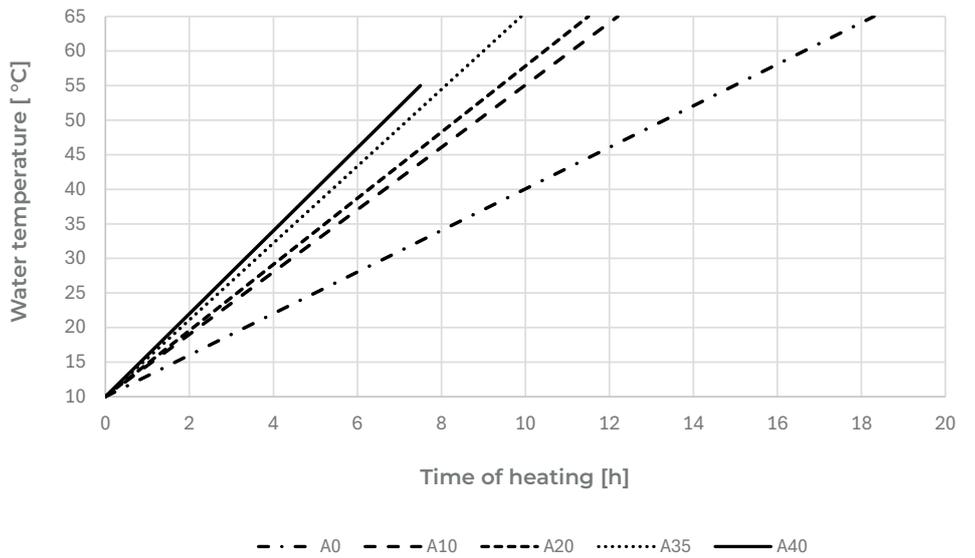


Water heating time shown for heat pump operation only, without electric heater.

EFFICIENCY (COP)


Ambient air configuration

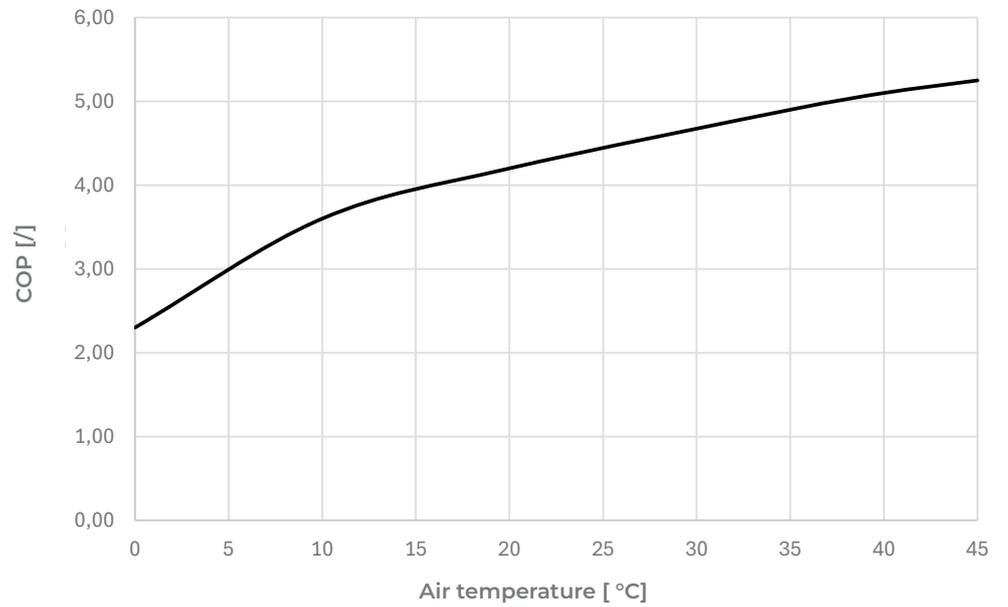

Ducted air configuration

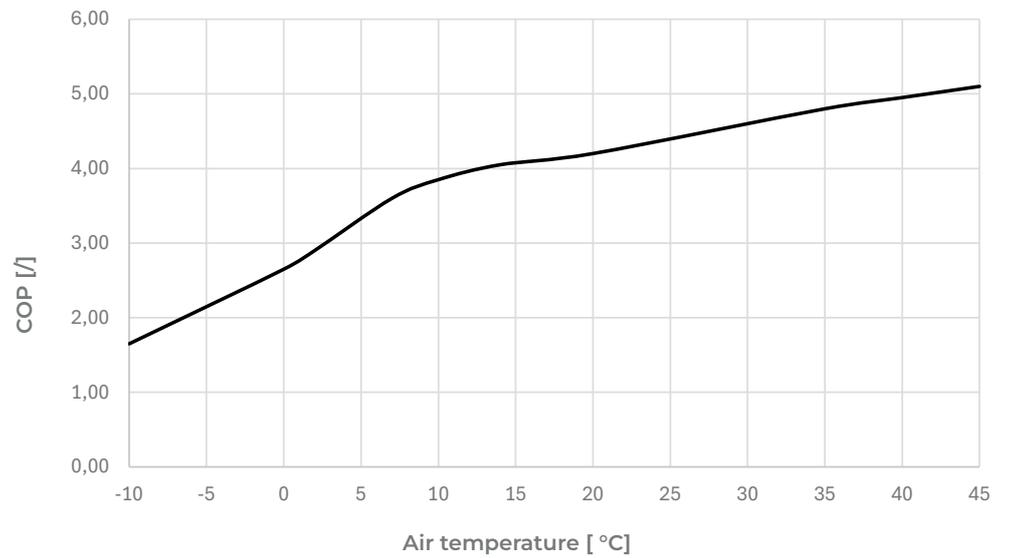


—
AVAILABLE HOT WATER VOLUME

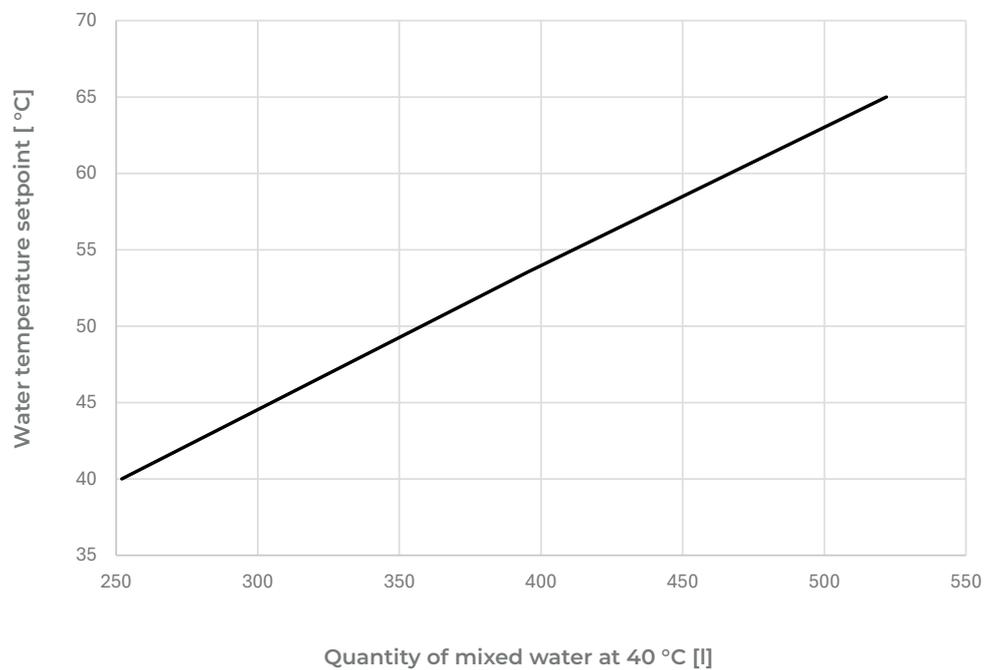

BASIC INSTALLATION DIAGRAM

Ambient air configuration

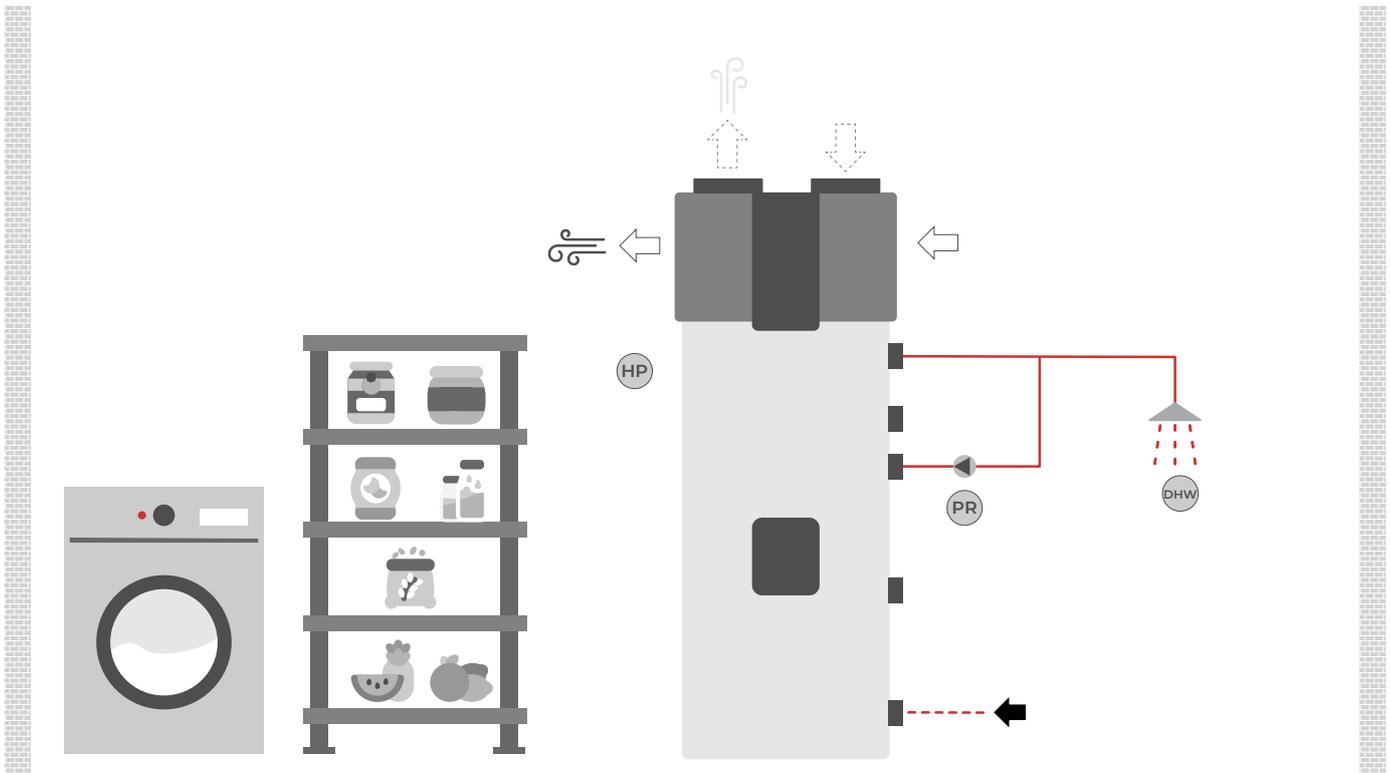


DHW	Domestic hot water
HP	Heat pump
PR	Recirculation pump for domestic hot water

A representative selection of items from the KRONOTERM sales program is shown.
For accurate system planning, please refer to the "Preparing for Installation" section of the instructions or consult your chosen system designer.

BASIC INSTALLATION DIAGRAM

Air source switching

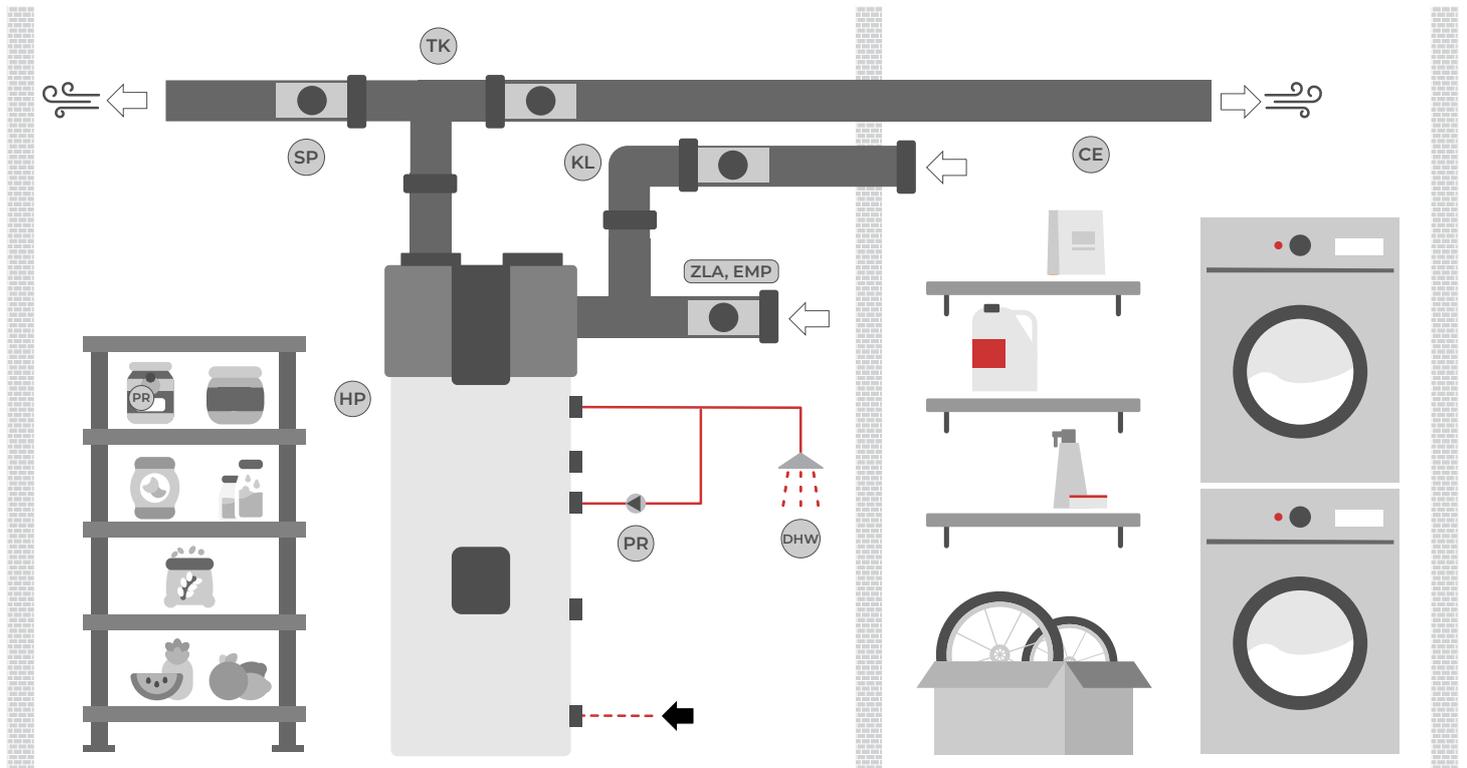


- CE Ventilation pipe
- DHW Domestic hot water
- HP Heat pump
- KL Elbow
- PR Recirculation pump for domestic hot water
- SP Ventilation pipe coupling
- TK T-piece
- ZLA, EMP Butterfly valve with drive

A representative selection of items from the KRONOTERM sales program is shown.

For accurate system planning, please refer to the "Preparing for Installation" section of the instructions or consult your chosen system designer.

BASIC INSTALLATION DIAGRAM

Ducted air configuration

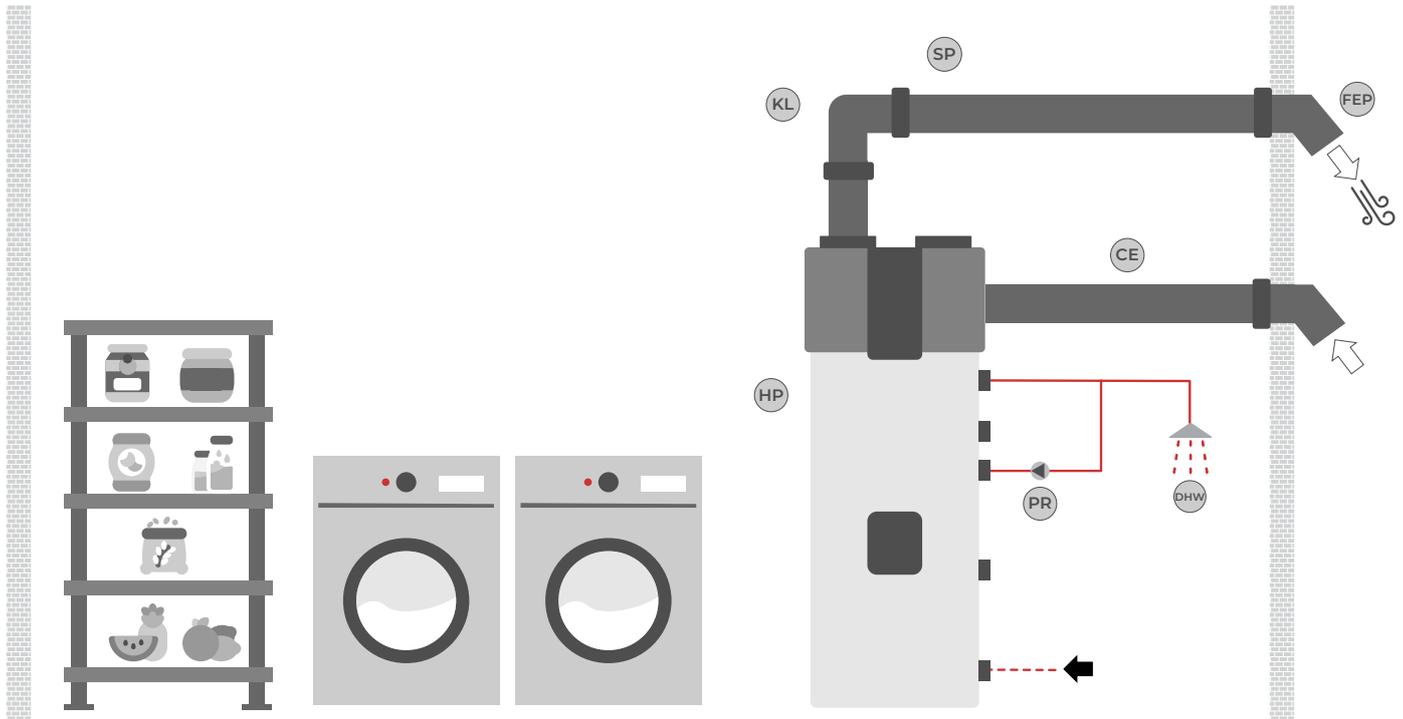


CE	Ventilation pipe
DHW	Domestic hot water
FEP	Facade element
HP	Heat pump
KL	Elbow
PR	Recirculation pump for domestic hot water
SP	Ventilation pipe coupling

A representative selection of items from the KRONOTERM sales program is shown.

For accurate system planning, please refer to the "Preparing for Installation" section of the instructions or consult your chosen system designer.

BASIC INSTALLATION DIAGRAM

Exhaust air utilisation from heat recovery

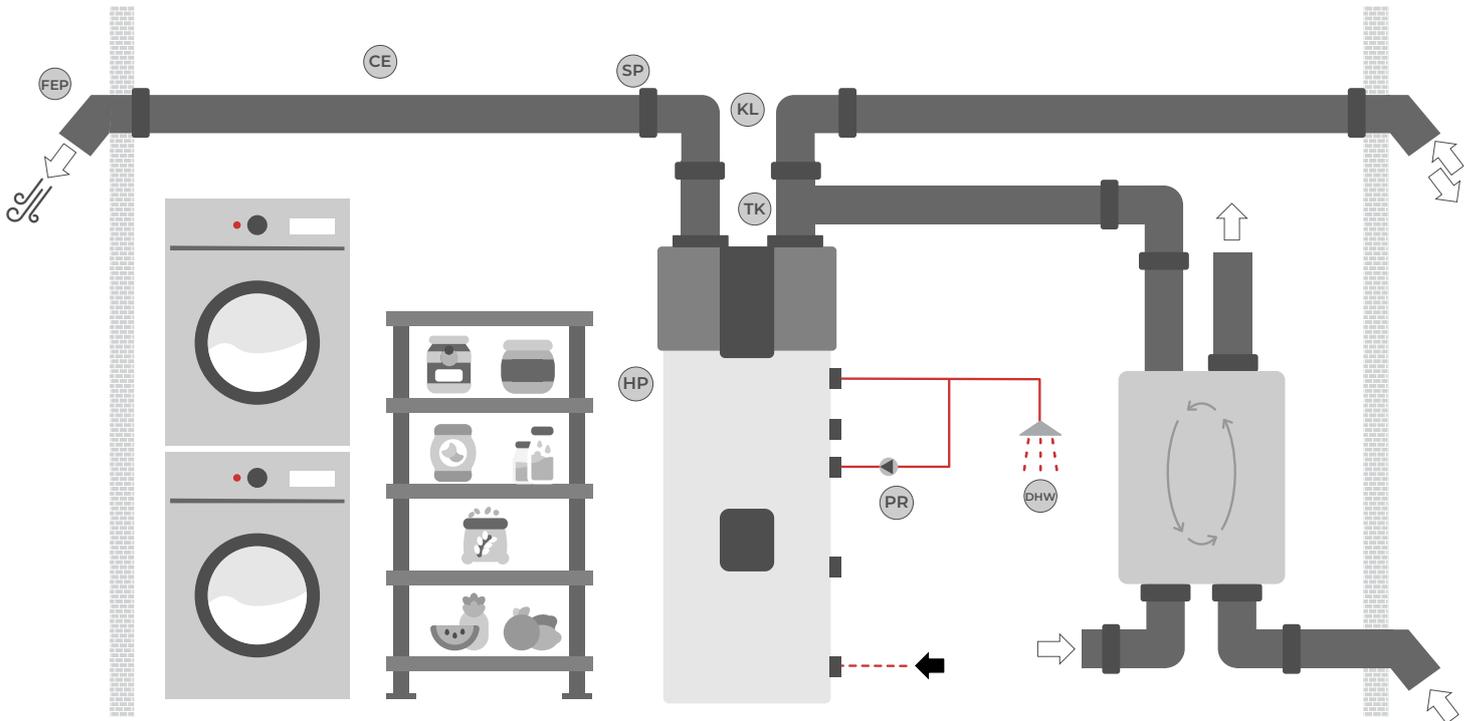


- | | |
|-----|---|
| CE | Ventilation pipe |
| DHW | Domestic hot water |
| FEP | Facade element |
| HP | Heat pump |
| KL | Elbow |
| PR | Recirculation pump for domestic hot water |
| SP | Ventilation pipe coupling |
| TK | T-piece |

A representative selection of items from the KRONOTERM sales program is shown.

For accurate system planning, please refer to the "Preparing for Installation" section of the instructions or consult your chosen system designer.

BASIC INSTALLATION DIAGRAM

Cascade connection

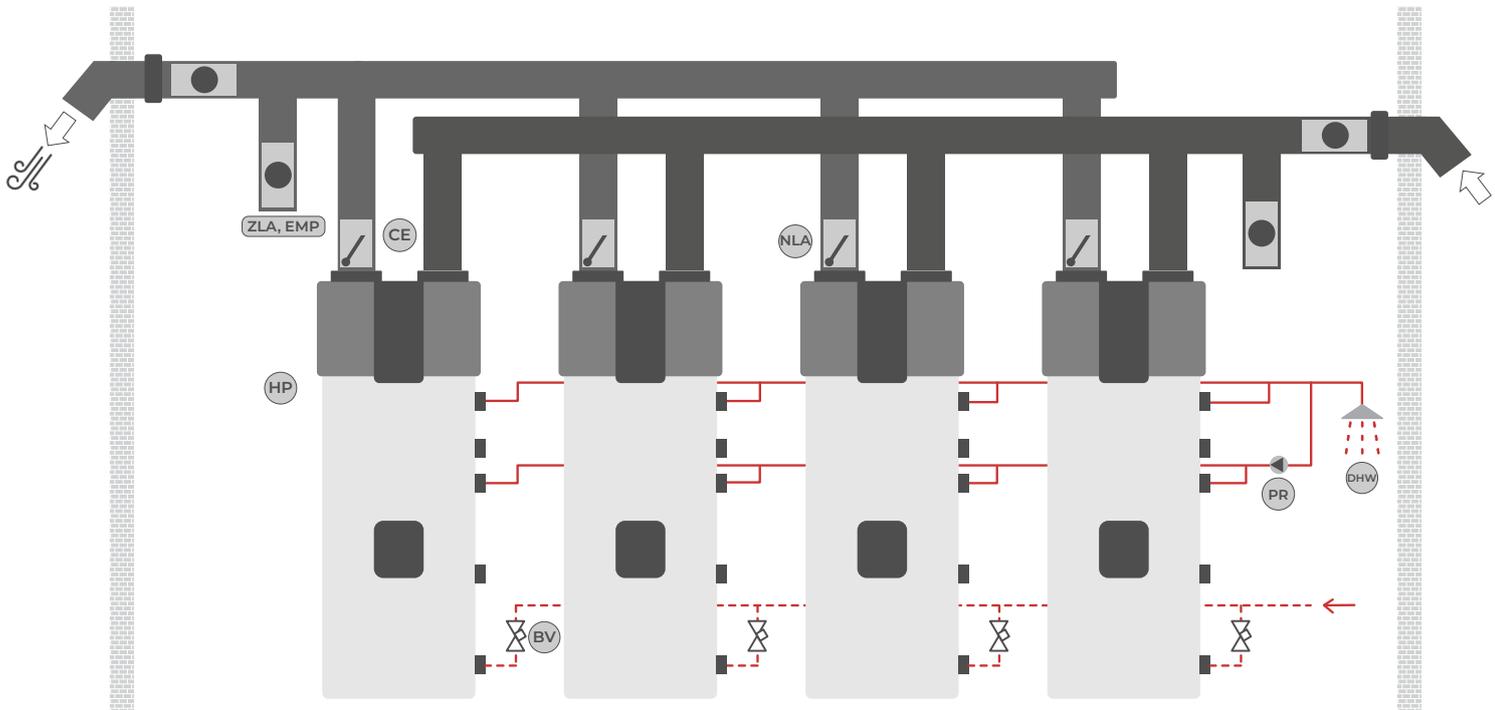


BV	Balancing valve
CE	Ventilation pipe
DHW	Domestic hot water
HP	Heat pump
NLA	Check valve
PR	Recirculation pump for domestic hot water
ZLA, EMP	Butterfly valve with drive

A representative selection of items from the KRONOTERM sales program is shown.
For accurate system planning, please refer to the "Preparing for Installation" section of the instructions or consult your chosen system designer.

BASIC INSTALLATION DIAGRAM

Biomass furnace connection

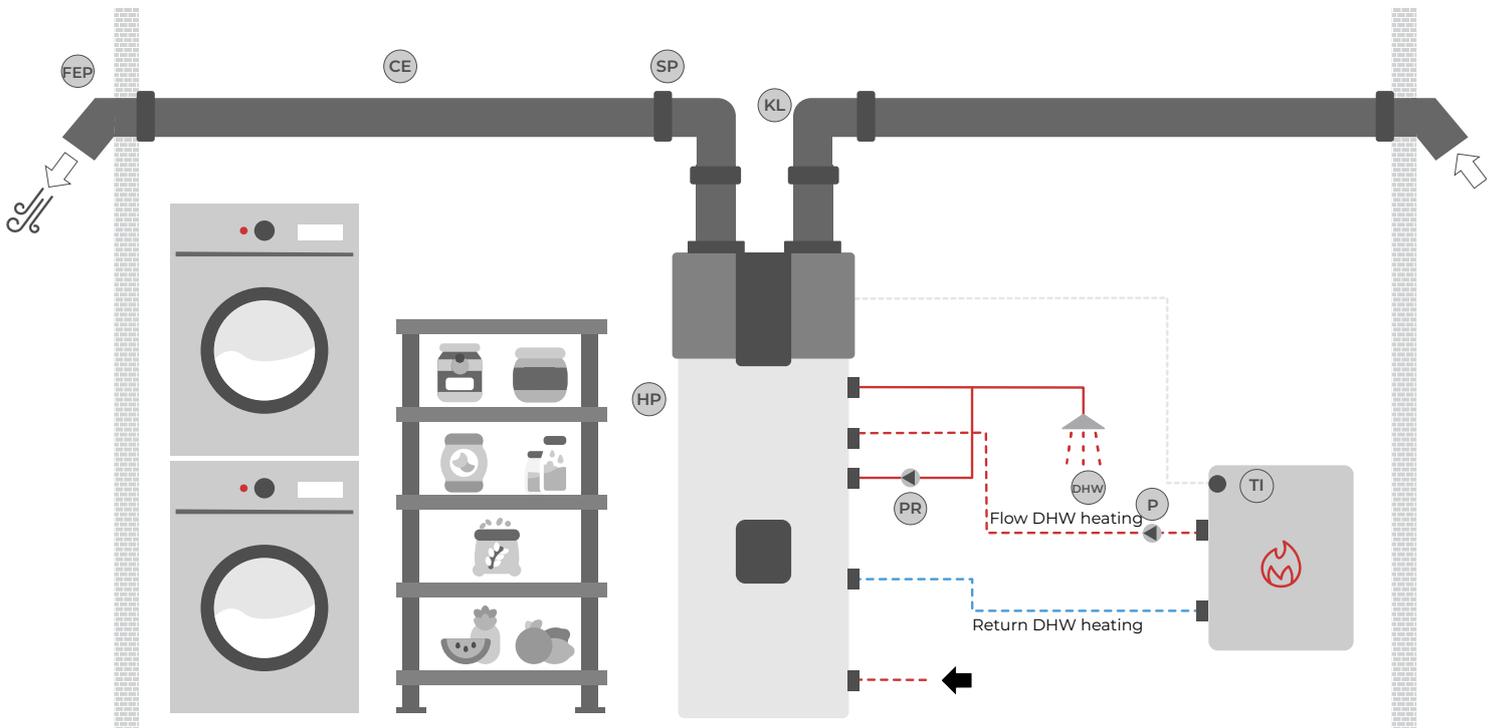

CE	Ventilation pipe
DHW	Domestic hot water
FEP	Facade element
HP	Heat pump
KL	Elbow
P	Circulation pump
PR	Recirculation pump for domestic hot water
SP	Ventilation pipe coupling
TI	Temperature sensor

A representative selection of items from the KRONOTERM sales program is shown.
For accurate system planning, please refer to the "Preparing for Installation" section of the instructions or consult your chosen system designer.

KRONOTERM d.o.o.

Trnava 5e, 3303 Gomilsko, SLO

T +386 3 703 16 20

www.kronoterm.com

info@kronoterm.com